

ACOUSTIC DOOR

AS-33-FRB

TECH SHEET—AS-33-FRB

Issue: 13-12-04

4 hr fire rated 33 Rw single acoustic / smoke / fire door

DESCRIPTION

Pyropanel AS-33-FRB is a 30 Rw, 4 hour fire rated 48mm single leaf acoustic door that utilises a Raven Products RP24 perimeter seal and an RP38 bottom seal used in conjunction with a Pyropanel 'Pyrosill' sill seal

APPLICATIONS

Ideal for applications that require 4 hours of fire resistance and an acoustic rating of 33 Rw, such as warehouses, factories and fire escapes.

FEATURES

Acoustic Rating

- 33 Rw (33 STC)

Test Certificate number

- TL409(i)

Fire Resistance

- FRL -/240/30

Door Configuration

- Single leaf hung in a steel frame

Perimeter Seal

- Raven RP24

Bottom Seal

- Raven RP38, and
- Pyropanel "Pyrosill" sill seal

Thickness

- 48mm (Nominal)

Size

- Maximum Size - 3000 x 1500

Hinges

- Minimum 3 steel hinges

Frame

- Packed pressed metal frame

Finish


- STEEL as standard

OPTIONAL EXTRAS

- Pre-hung in steel frame
- Veneer or Laminate facings can be applied over steel face
- Vision panels - 300 x 200 or 250 x 250mm.
- Kick Panels of 1.2mm Stainless Steel to selected height
- Meets the BCA requirement for a smoke door.
- Alternative seal combination using Pyropanel Euroseal® instead of Raven RP24 - Acoustic rating becomes 30 Rw (test certificate number CSIRO TL409(g)).

INSTALLATION

Door frame must be tightly sealed against wall structure using Pyropanel Multiflex or approved alternative fire and acoustic sealant. Metal door frames will require packing with Pyropanel FR board, Fire rated plaster, concrete or mortar to achieve desired acoustic and fire rating.

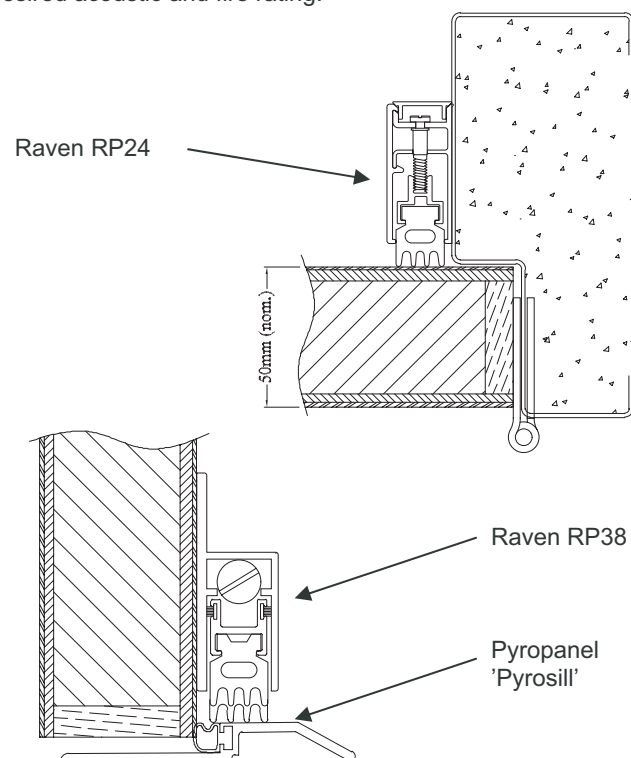

HOW TO SPECIFY

"Door to be a Pyropanel AS-33-FRB acoustic door with -/240/30 FRL, installed into a packed metal door frame"*

* denotes example—delete, change or specify as required



UNITED DOORMAKERS

Melba Industrial Park, Factory 2,
122-124 Beresford Road, Lilydale,
Victoria 3140, Australia.

T: +61 3 9735 3911 F: +61 3 9735 5411

W: www.udm.com.au E: sales@udm.com.au

Part of the

PYRO PANEL

Group